

From: [Pui Ming Leung](#)
To: [Committee of Adjustment \(SM\)](#)
Subject: COA, Kitchener
Date: Tuesday, June 3, 2025 11:37:04 AM
Attachments: [11111.pdf](#)

Hi,

Sorry for my late response. I apologize for any inconvenience caused.

90 Wood ST – make sure to have clearance to primary cable on York St according to our standard D11111 (attached here)

For all new service or upgrade, please send a request to Enova for hydro connection.


Thanks,

Pui Ming Leung (she/her) | Design Technologist

Direct Number: 226-896-2200 (EXT 6205)
Mobile Number: 519-589-2659
puiiming.leung@enovapower.com
301 Victoria Street South, Kitchener, Ontario, N2G 4L2
enovapower.com



This correspondence is directed in confidence solely to the addressees listed above. It may contain personal or confidential information and may not otherwise be distributed, copied or used by the intended recipient. If you are not the intended recipient, please delete the e-mail and any attachments and notify the sender immediately. Click on the link to read the additional disclaimer: <https://enovapower.com/disclaimer>

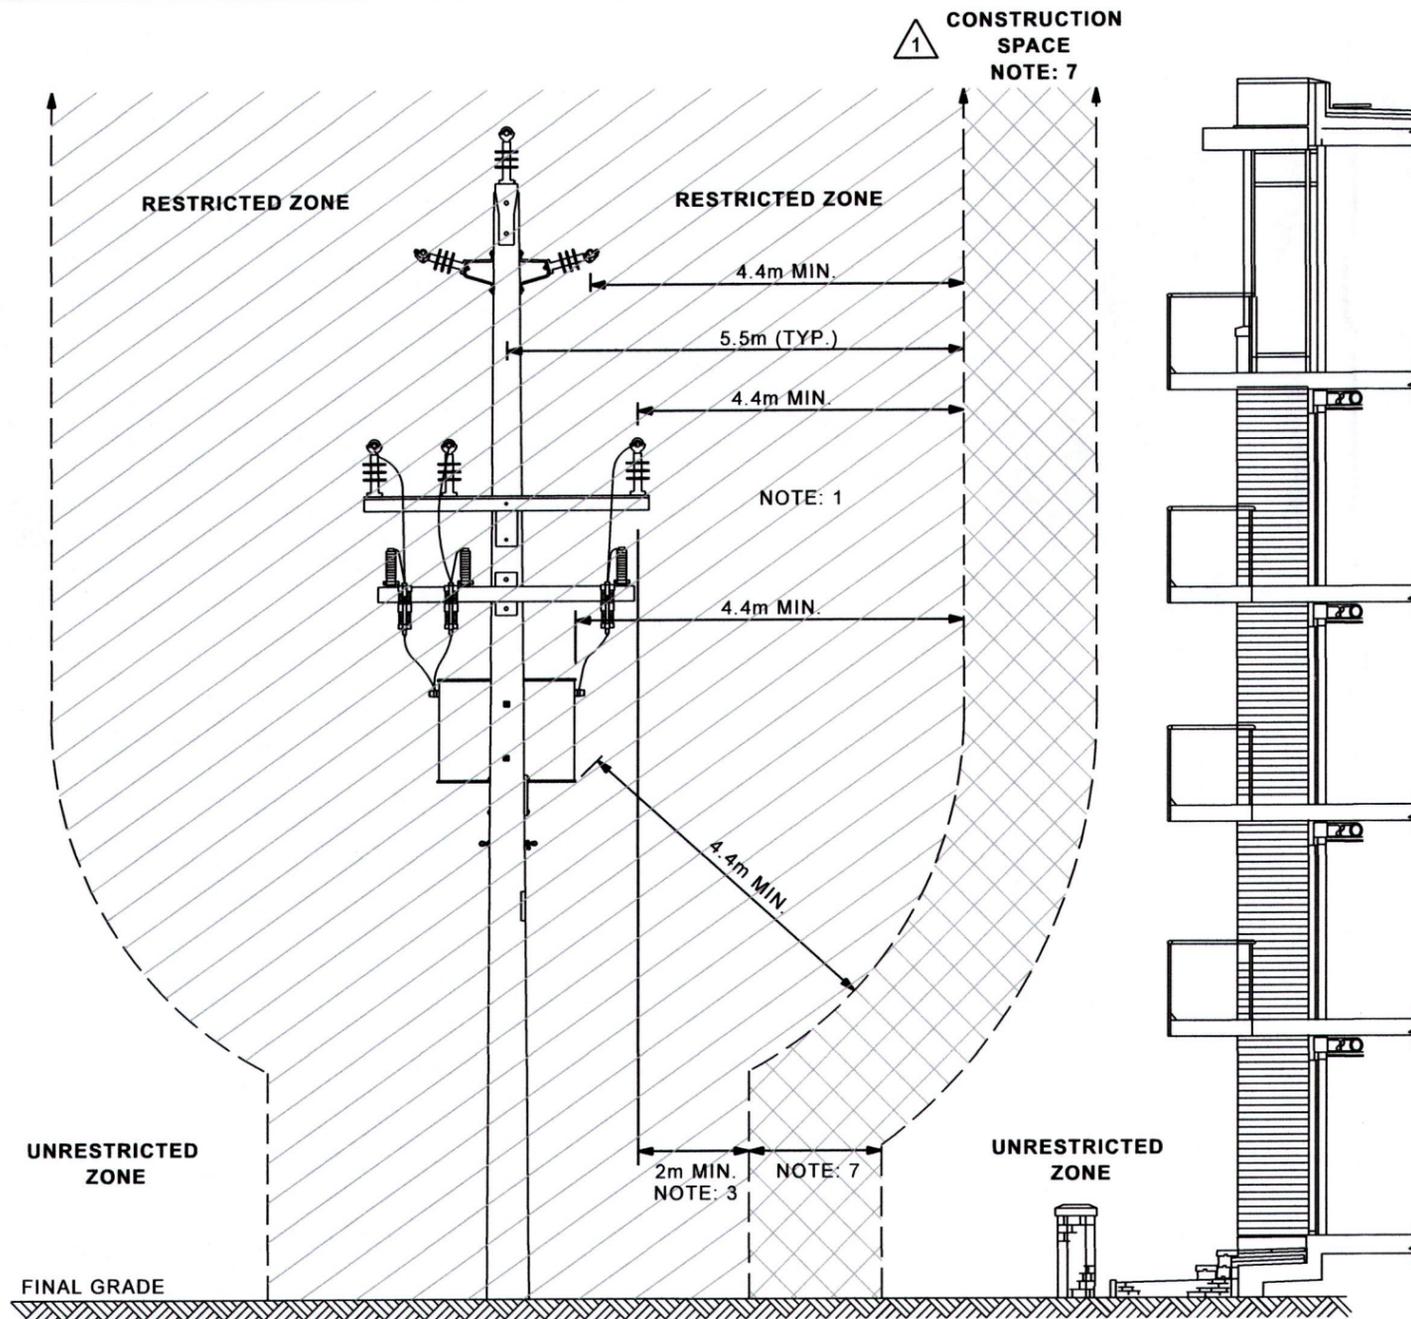

NOTES:

1. NO PERMANENT BUILDING OR STRUCTURE SHALL BE PLACED WITHIN 4.4 METRES MEASURED RADIALLY FROM ANY PRIMARY VOLTAGE CONDUCTOR OR EQUIPMENT, MEASURED FROM THE CLOSEST PRIMARY CONDUCTOR (AT REST) TO THE CLOSEST POINT OF THE BUILDING OR STRUCTURE.
2. A MINIMUM HORIZONTAL SEPARATION OF 1.6 METRES FROM THE BUILDING OR STRUCTURE TO THE SECONDARY CONDUCTOR (<750V) SHALL BE MAINTAINED, UNLESS THE SECONDARY CONDUCTORS ARE ATTACHED TO THE BUILDING (EG. A SERVICE CONDUCTOR).
3. NO PERMANENT BUILDING OR STRUCTURE SHALL BE PLACED OR CONSTRUCTED WITHIN 2 METRES HORIZONTAL SEPARATION FROM THE OUTERMOST OVERHEAD PRIMARY CONDUCTOR (AT REST).
4. ZERO VOLTAGE SUPPORT WIRES (I.E. SPAN GUYS) MAY CROSS OVER THE CUSTOMER'S STRUCTURE AND SHALL MAINTAIN AT LEAST 2.5 METRES VERTICAL CLEARANCE TO THE CLOSEST PART OVER THE BUILDING STRUCTURE.
5. CONTACT ENOVA TO DETERMINE SPECIFIC CLEARANCES APPLICABLE TO YOUR PROJECT.
6. CALCULATED CLEARANCES ARE BASED ON CONDUCTORS AT MAXIMUM SWING POSITION, CSA STD C22.3 NO. 1-15 TABLE 12, AND THE ONTARIO HEALTH AND SAFETY ACT (OHSA).
7. CONSTRUCTION SPACE IS TO ACCOMMODATE SCAFFOLDING, SKYJACKS, WINDOW CLEANING, ETC. THERE SHALL BE NO ENCROACHMENT INTO THE RESTRICTED ZONE DURING CONSTRUCTION OR BUILDING MAINTENANCE. ENOVA WILL NOT PROVIDE COVER UP OR ISOLATION OF ITS ENERGIZED PRIMARY CONDUCTORS THAT LIE ALONG A CONSTRUCTION SITE.

△2	CONSTRUCTION SPACE DIMENSIONS REMOVED. NOTE 7 MODIFIED	JULY 7/23 B.M.
△1	CONSTRUCTION SPACE ADDED. NOTES REVISED.	JULY 7/23 B.M.
REV No.	DESCRIPTION	DATE & INITIALS



CLEARANCES TO ADJACENT STRUCTURES
8.32KV - 27.6KV

Enova Power Corp.
Certificate of Approval

The installation work covered by this document meets the safety requirements of Section 4 of Ontario Regulation 22/04.

Name of P.Eng.: *Shawn Wang*

Signature: *[Signature]*

Date: *Jan 4, 2024*

REV. 2 APPROVED: *[Signature]* Jan. 10, 2024

REV. 1 SEALED BY X. WANG ON JULY 20/23

REV. 0 SEALED BY X. WANG ON JUNE 23/21

PREVIOUS SEALED REVISIONS

DRAWN	B. BIN	JUL. 21/20	SCALE NONE
DESIGNED	S. WANG	JUNE 18/2021	D11111
CHECKED	S.W.		
APPROVED	G.A. CAMERON	JUNE 24/21	
FILE No.	6061-91-1		